



OIL-WET INCLINING PLATFORM SLIP RESISTANCE TEST

Senso 2mm Self-Adhesive

Prepared for: Gerflor Australasia Pty Ltd
Steve Gradecak
17 Cato Street
HAWTHORN EAST VIC 3123

Specimen Description: Senso 2mm Self-Adhesive, 184x500 mm.

No. of Specimens: 6 off

Surface Structure: Smooth

Specimen Preparation: Washed with water and pH neutral detergent, rinsed then dried.

Specimen Configuration: Unfixed

Test Direction: Test conducted parallel with surface profile.

Joint Type & Width: N/A

Air Temperature: 21°C

Test Standard: AS 4586:2013 Slip resistance classification of new pedestrian surface materials, Appendix D - Oil Wet Inclining Platform Test

Test Shoe: Leipzig V73-SP

Test Location: ATTAR, 44-48 Rocco Drive, Scoresby..

Test Date: 11 March 2021

Test Personnel: Awel Guled and Dale Siegle

Displacement Space (rounded to the nearest 0.5cm ³ /dm ²):	Not tested
Displacement Space Assessment Group (Appendix E, AS 4586 - 2013):	Not tested
Corrected mean overall acceptance angle (α_{ave}) (rounded down to the nearest degree):	7°
Classification:	R9

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance procedures and wear on their slip resistance be checked.

Reviewed By:



Awel Guled
Compliance and Test Technician
Approved Signatory



Dale Siegle
Compliance and Test Technician
Approved Signatory

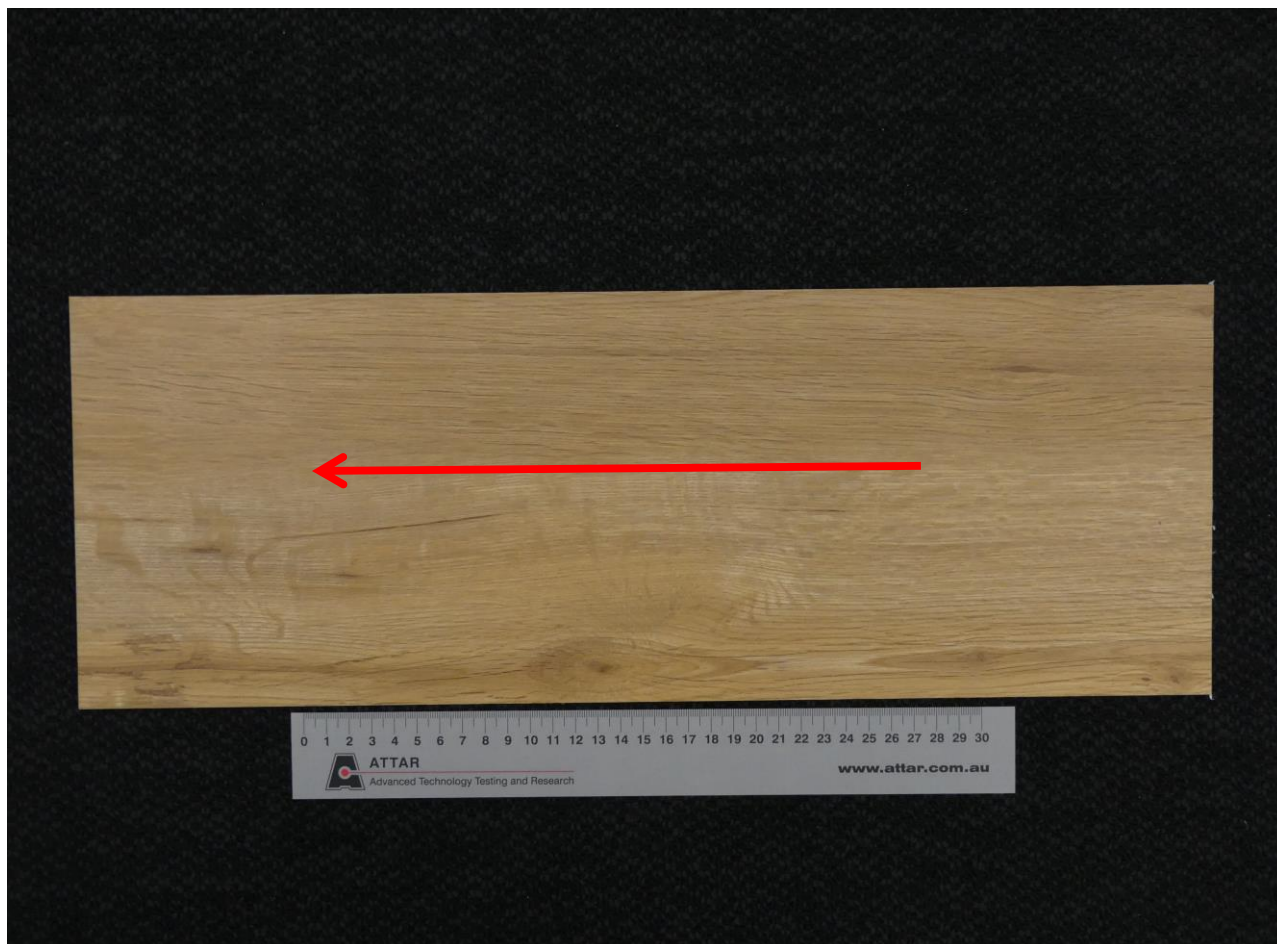


Figure 1: Senso 2mm Self-Adhesive
Arrow indicates direction of testing

CLASSIFICATION CRITERIA – AS 4586 - 2013
Oil Wet Inclining Platform Test – Appendix D

Compliance

TABLE 5: CLASSIFICATION OF PEDESTRIAN SURFACE MATERIALS ACCORDING TO THE OIL-WET INCLINING PLATFORM TEST

Classification	Angle, degrees
No Classification	<6
R9	≥6 <10
R10	≥10 <19
R11	≥19 <27
R12	≥27 <35
R13	≥35