



Accredited for compliance with ISO/IEC 17025 – Testing
NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration and inspection reports
Accreditation No. 2735

OIL-WET INCLINING PLATFORM SLIP RESISTANCE TEST

Tarasafe Standard

Prepared for: Gerflor
Deepal Khatri
Suite 2.02, 315 Ferntree Gully Road
MOUNT WAVERLEY VIC 3149

Sample Description: Tarasafe Standard

No. of Specimens & Size Supplied: 1 off, 503x1005 mm, (Sampling Conducted by Client)

Surface Structure: Structured

Specimen Preparation: Washed with water and pH neutral detergent, rinsed then dried.

Specimen Configuration: Fixed

Test Direction: Test direction not applicable.

Joint Type & Width: N/A

Air Temperature: 21°C

Test Standard: AS 4586:2013 Slip resistance classification of new pedestrian surface materials, Appendix D - Oil Wet Inclining Platform Test

Test Shoe: Leipzig V73-SP

Test Location: ATTAR 44-48 Rocco Drive, Scoresby, VIC, 3179

Test Date: 17 April 2026

Test Personnel: Marcus Bosworth and Sebastian Podsiadly Soto

| | |
|---|------------|
| Displacement Space (rounded to the nearest 0.5cm ³ /dm ²): | Not tested |
| Displacement Space Assessment Group (Appendix E, AS 4586 - 2013): | Not tested |
| Corrected mean overall acceptance angle (α_{ave}) (rounded down to the nearest degree): | 15° |
| Classification: | R10 |

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance procedures and wear on their slip resistance be checked.

Prepared By:



Marcus Bosworth
Compliance and Testing Technician

Reviewed By:



Marcus Braché
Senior Engineering Technician
Approved Signatory

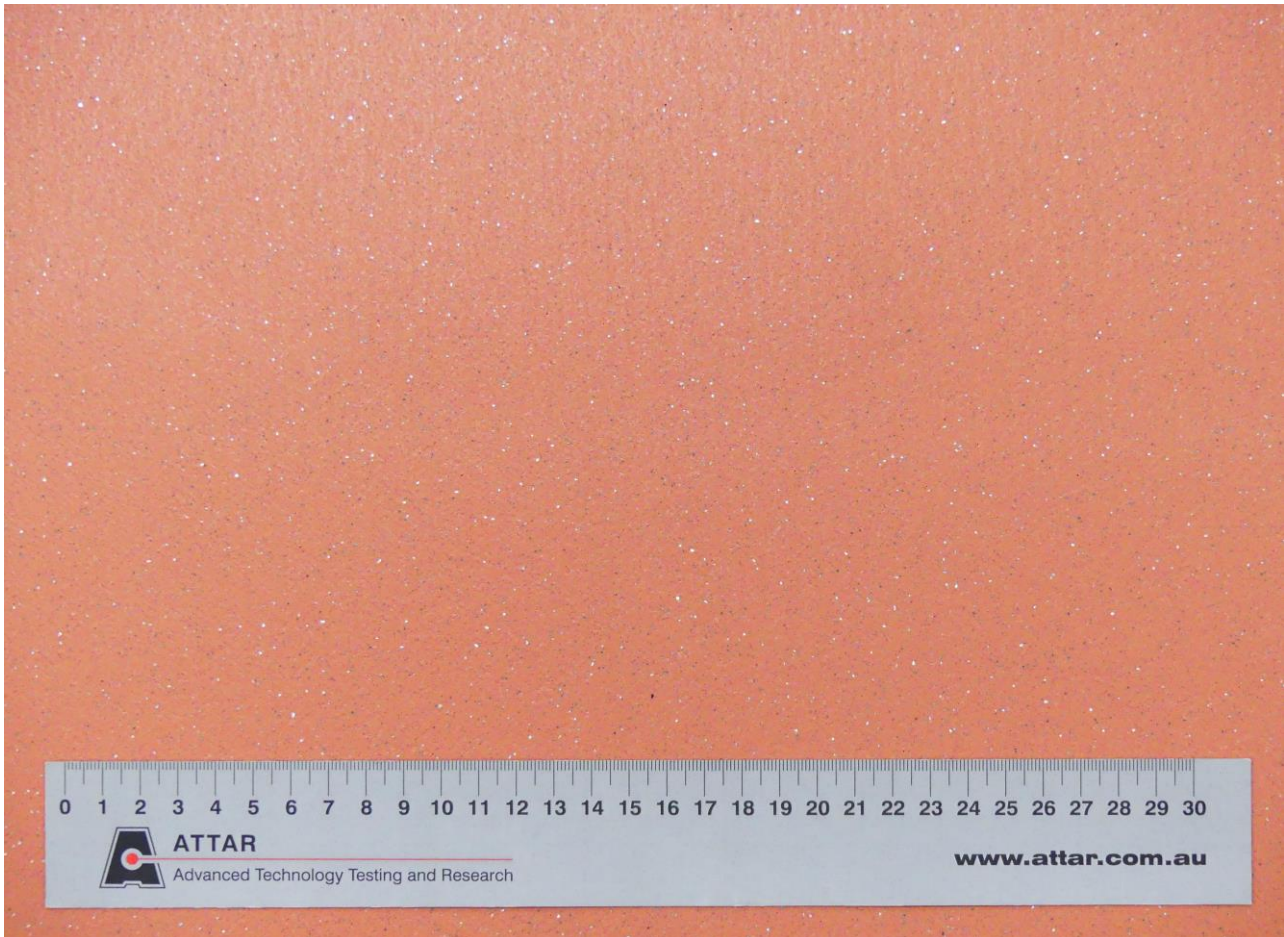


Figure 1: Tarasafe Standard



CLASSIFICATION CRITERIA – AS 4586 - 2013
Oil Wet Inclining Platform Test – Appendix D

Compliance

TABLE 5: CLASSIFICATION OF PEDESTRIAN SURFACE MATERIALS ACCORDING TO THE OIL-WET INCLINING PLATFORM TEST

| Classification | Angle, degrees |
|-----------------------|-----------------------|
| No Classification | <6 |
| R9 | ≥6 <10 |
| R10 | ≥10 <19 |
| R11 | ≥19 <27 |
| R12 | ≥27 <35 |
| R13 | ≥35 |